


566-35760

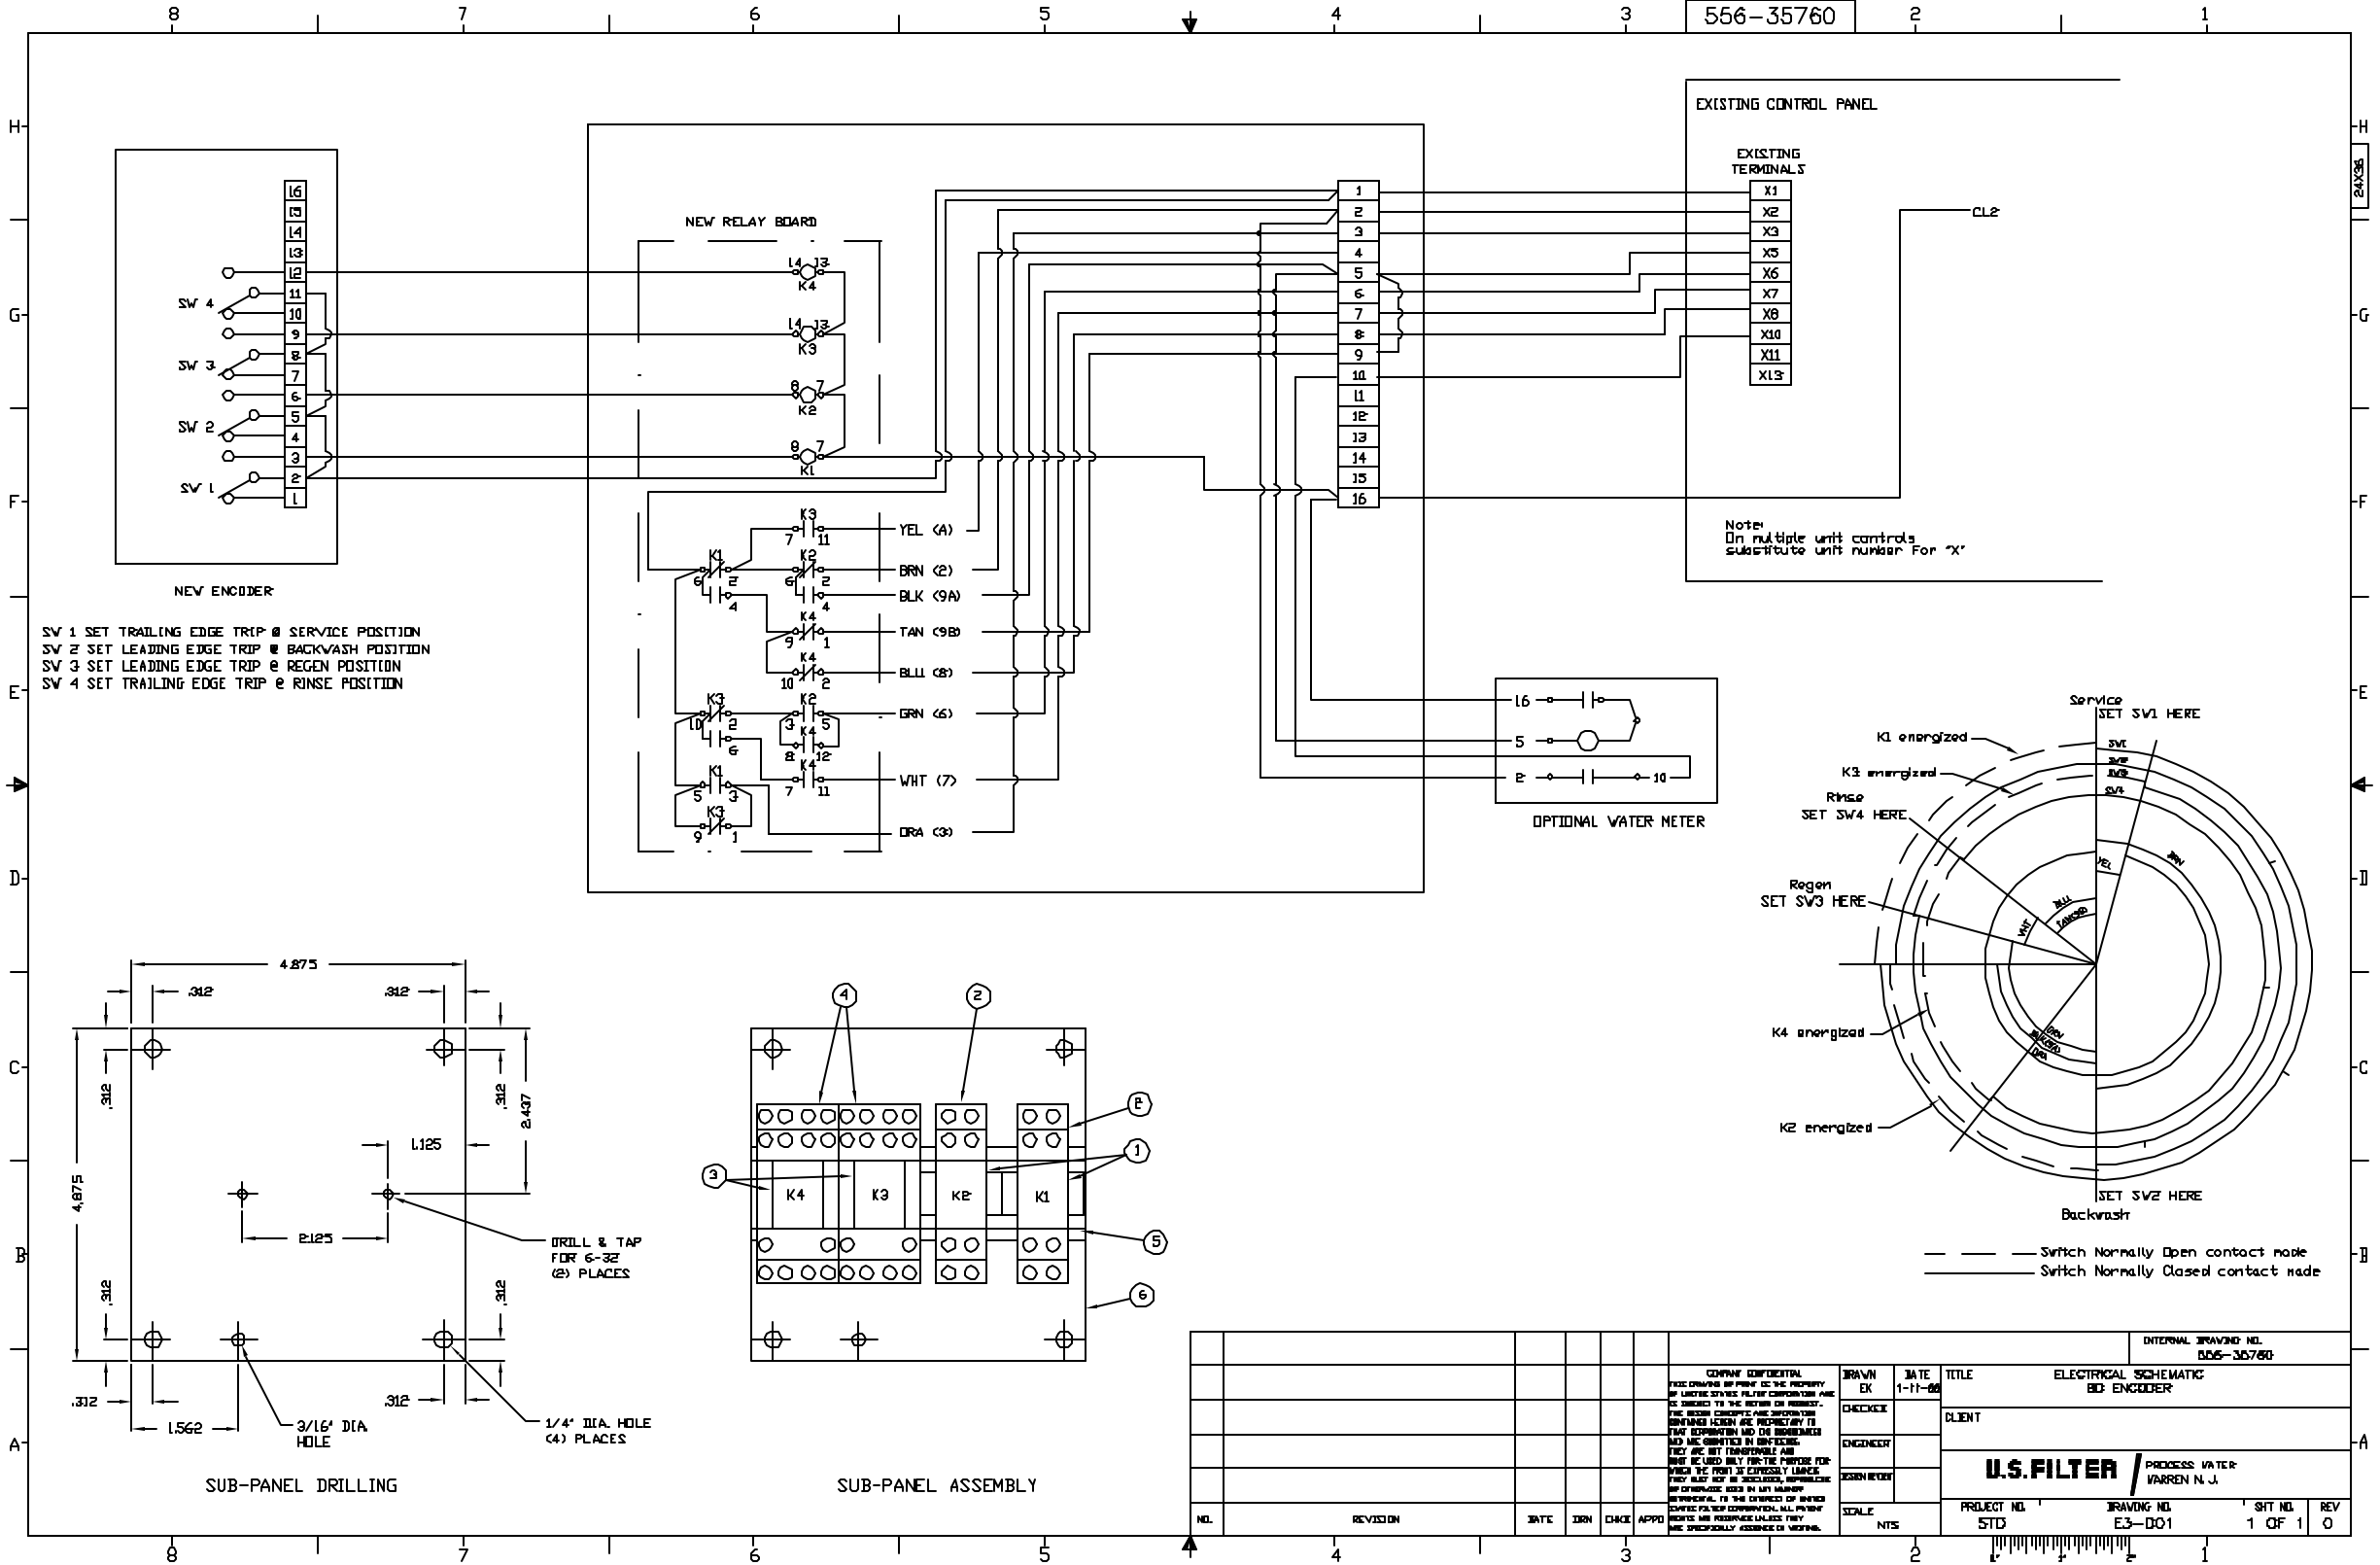

SV 1 SET TRAILING EDGE TRIP @ SERVICE POSITION
 SV 2 SET LEADING EDGE TRIP @ BACKWASH POSITION
 SV 3 SET LEADING EDGE TRIP @ REGEN POSITION
 SV 4 SET TRAILING EDGE TRIP @ RINSE POSITION

EXISTING CONTROL PANEL

EXISTING TERMINALS

Note:
 On multiple unit controls
 substitute unit number for "X"

OPTIONAL WATER METER

SUB-PANEL DRILLING

SUB-PANEL ASSEMBLY

--- Switch Normally Open contact made
 ——— Switch Normally Closed contact made

COMPANY CONFIDENTIAL <small>THIS DRAWING IS THE PROPERTY OF U.S. FILTER WATER SYSTEMS AND IS LOANED TO THE USER OF THIS DRAWING. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF U.S. FILTER WATER SYSTEMS. THIS DRAWING IS THE PROPERTY OF U.S. FILTER WATER SYSTEMS AND IS LOANED TO THE USER OF THIS DRAWING. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF U.S. FILTER WATER SYSTEMS.</small>										DRAWN EK		DATE 1-11-00		TITILE ELECTRICAL SCHEMATIC ENCODER				DRAWING NO. 006-35760	
CHECKED										CLIENT		U.S. FILTER / PROCESS WATER WARREN N.J.							
ENGINEER										PROJECT NO. STD		DRAWING NO. E3-001		SHEET NO. 1 OF 1		REV 0			
DESIGN REVIEW										SCALE NTS									
NO.										REVISION		DATE		ISSN		CHECK		APPRO	